




AIR QUALITY WALL SENSOR INSTALLATION INSTRUCTIONS



WARNING - RISK OF FIRE AND ELECTRICAL SHOCK. DEVICE MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN ONLY. DEVICE IS INTENDED FOR INSTALLATION IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, LOCAL AND FEDERAL SPECIFICATIONS. DISCONNECT POWER AT ELECTRICAL PANEL BEFORE SERVICING. RETAIN THESE INSTRUCTIONS FOR MAINTENANCE REFERENCE.

INSTALLATION

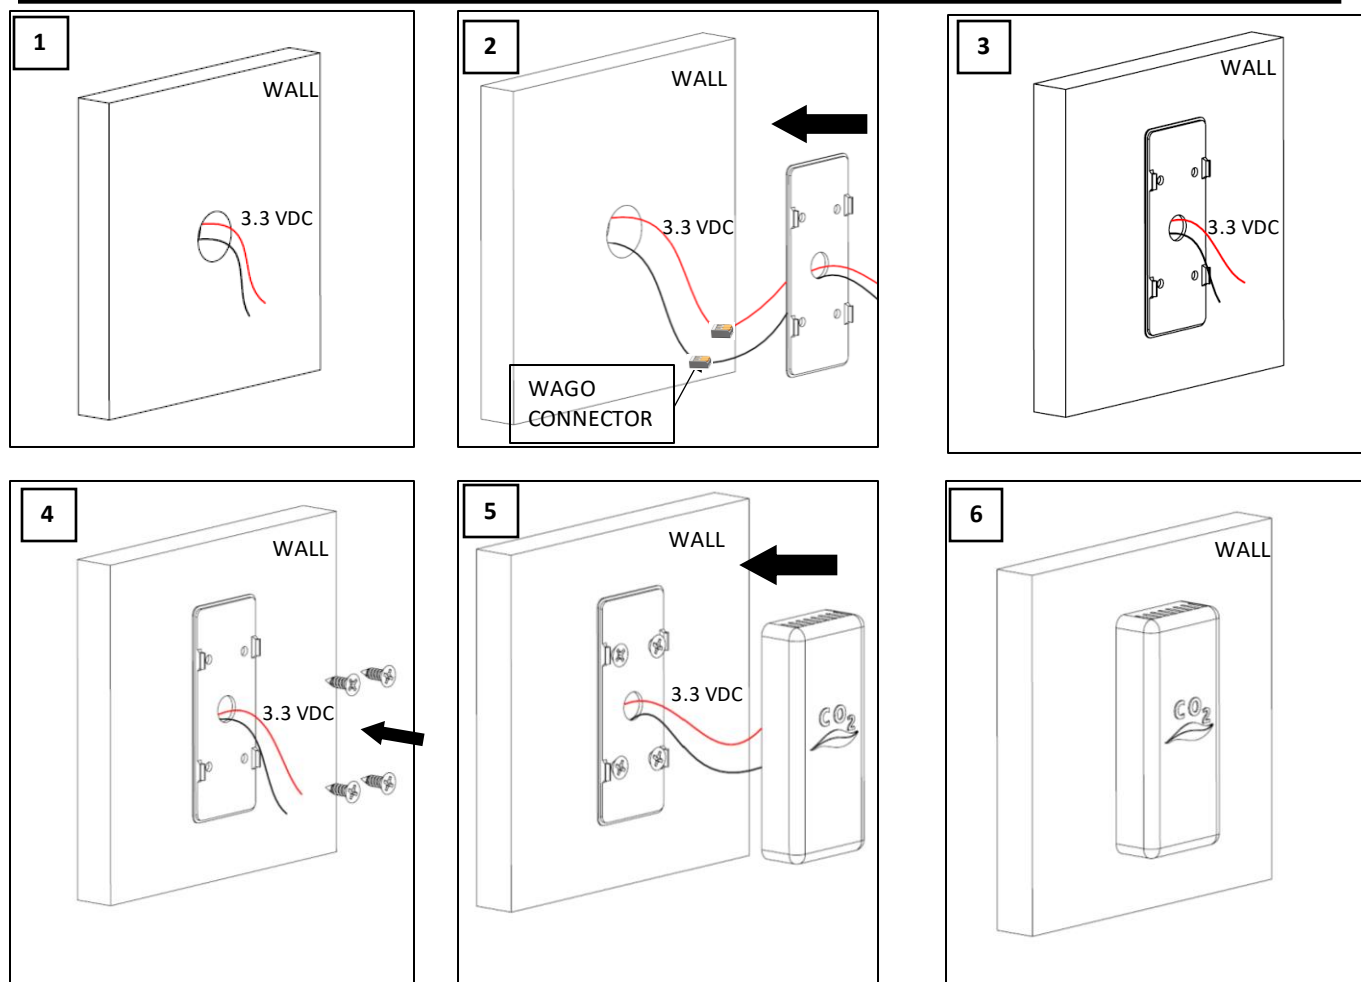

1. INSTALL AC/DC TRANSFORMER (3.3 VDC) (PROVIDED BY US). DRILL A HOLE AT DESIRED INSTALLATION HEIGHT (SUGGESTED 60" FROM FLOOR LEVEL). PULL OUT LOW VOLTAGE (3.3 VDC) WIRES FROM TRANSFORMER OUTPUT THROUGH THE HOLE. (FIGURE 1)
2. CONNECT THE CO2 SENSOR TO THE LOW VOLTAGE POWER LINE (3.3 VDC) USING WAGO CONNECTORS. RED TO RED AND BLACK TO BLACK. MAKE SURE TO PUT THE WIRES AND WAGO INSIDE THE WALL HOLE. (FIGURE 2)
3. ALIGN THE BACKPLATE TO THE HOLE AND PLACE THE BACK PLATE ON THE WALL. (FIGURE 3)
4. FIX THE BACKPLATE USING 4X DRYWALL SCREWS (BY OTHERS). (FIGURE 4)
5. ATTACH THE CO2 SENSOR COVER TO THE BACK PLATE. GENTLY PUSH CO2 SENSOR COVER INTO THE BACKPLATE. (FIGURE 5)